


CRESTON VALLEY

TOWN of CRESTON



2025 **Annual Water Report**

Table of Contents

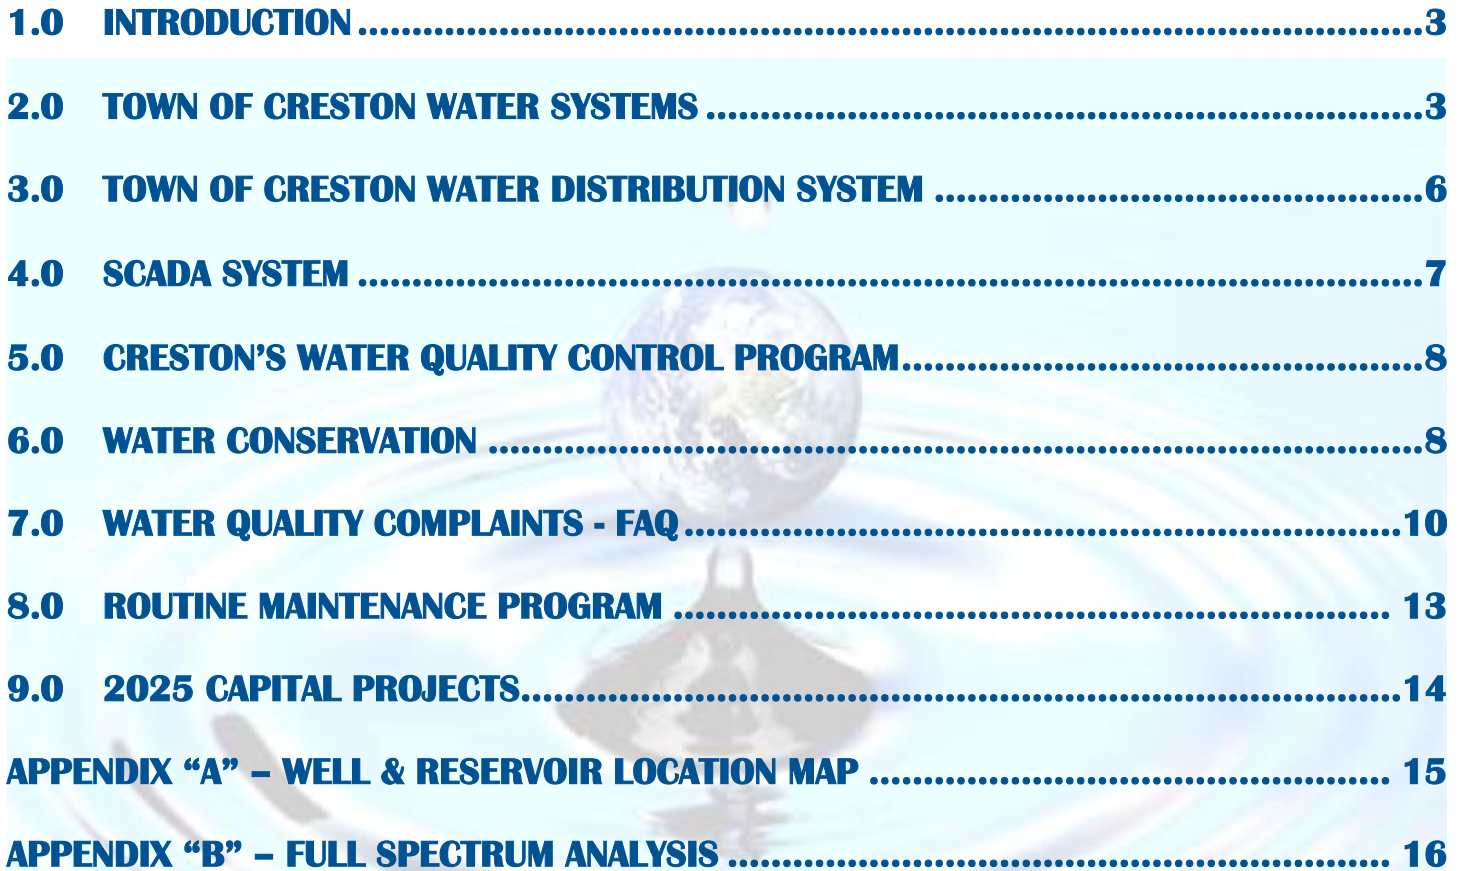

| | |
|---|-----------|
| 1.0 INTRODUCTION | 3 |
| 2.0 TOWN OF CRESTON WATER SYSTEMS | 3 |
| 3.0 TOWN OF CRESTON WATER DISTRIBUTION SYSTEM | 6 |
| 4.0 SCADA SYSTEM | 7 |
| 5.0 CRESTON'S WATER QUALITY CONTROL PROGRAM..... | 8 |
| 6.0 WATER CONSERVATION | 8 |
| 7.0 WATER QUALITY COMPLAINTS - FAQ | 10 |
| 8.0 ROUTINE MAINTENANCE PROGRAM | 13 |
| 9.0 2025 CAPITAL PROJECTS..... | 14 |
| APPENDIX "A" – WELL & RESERVOIR LOCATION MAP | 15 |
| APPENDIX "B" – FULL SPECTRUM ANALYSIS | 16 |

1.0 INTRODUCTION

The Town of Creston is the purveyor of potable drinking water to users connected to the Town of Creston community water system. This report is provided in fulfillment of the Town's obligations under the *Provincial Drinking Water Act* and associated regulations, as well as the terms and conditions of the Town's Water System Operating Permit. Enforcement of the regulations and issuance of water system permits are the responsibility of the Interior Health Authority.

2.0 TOWN OF CRESTON WATER SYSTEMS

The Town of Creston has 3 separate water sources available to provide drinking water to the community.

The primary supply of potable water is delivered from the Arrow Creek Water Treatment Plant that is operated by the Regional District of Central Kootenay (RDCK). The water system derives source water from Arrow Creek, which is classified as a Community Watershed, supplying water to both Erickson and Creston. The creek has benefited for many years from an ongoing water quality monitoring program. Historic water quality data for Arrow Creek indicates that, in general, the water quality falls within acceptable levels for the majority of parameters in the Canadian Drinking Water Quality Guidelines. Coliform levels, however, typically exceed the criteria and exhibit high seasonal variability.

Although the water system was first developed in 1929, unsafe water quality issues due to the inadequate treatment processes resulted in a new water treatment plant being commissioned on Arrow Creek in 2005. The \$9.3 million treatment process includes coarse screening, settling, fine screening, membrane filtration, UV disinfection, and residual disinfection by chlorination.



Arrow Creek Ultra-violet Disinfection Equipment

An indication of the effectiveness for the Arrow Creek Water Filtration Plant, which utilizes a Zenon Hollow-Fiber Ultra Filtration process, are listed below:

| | | |
|-------------------------------------|------------|----------------------------------|
| Number of filter trains | 4 | |
| Number of cassettes per train | 3 | (with space for one additional) |
| Total number of cassettes | 12 | (with space for four additional) |
| Number of modules per cassette | 69 | |
| Total number of modules | 828 | |
| Number of fibers per module | 29,000 | |
| Total number of fibers | 24,012,000 | |
| Membrane surface area per module | 37.16 | (square metres) |
| Total membrane surface area | 30,768 | (square metres) |
| Single fiber outside diameter | 700 | (microns) (= 0.7 mm) |
| Single fiber inside diameter | 400 | (microns) (= 0.4 mm) |
| Single fiber sidewall pore diameter | 0.02 | (microns) |
| Human hair diameter | 76 | (microns) |

| Filtration Plant Minimum Requirement for Permeate (Filtered Water) | | |
|---|---------------------------|--------------------------------|
| Maximum turbidity | 0.1 NTU | (Nephelometric Turbidity Unit) |
| Turbidity | <.05 NTU 95% of the time | |
| Giardia removal | >4 log removal | (99.99%) |
| Cryptosporidium removal | >4 log removal | (99.99%) |
| Virus removal | >3.5 log removal | (99.99%) |
| | | |
| Plant capacity | 20 million litres per day | (when raw water is 5 deg. C) |
| | 30 million litres per day | (when raw water is >10 deg. C) |
| | | |

Water from Arrow Creek accounts for over 99% of the current potable water supply for the Town of Creston. The treated water is monitored for free chlorine residual as it enters the main Creston reservoir, and an automated chlorination dosing system compensates for any low chlorine residual that may be present, ensuring safe disinfection for Creston consumers.

Additionally, the Town of Creston maintains two potable groundwater wells within the confines of Creston itself that are independently capable of providing an adequate potable water supply for the community. These wells were initially designed as a supplementary water supply during summer months when water production is at its peak, most especially during orchard watering operations. However, water conservation measures taken by the Town and Columbia Brewery, combined with water system optimization practices to streamline the peak water requirements from Arrow Creek, have effectively eliminated the requirement for the operation of the Creston groundwater source wells. Both wells are maintained and run weekly to ensure that the Town of Creston has a sustainable water supply in the event of any emergency contingency.



Arrow Creek Raw Water Supply



Arrow Creek Water Treatment Plant

3.0 TOWN OF CRESTON WATER DISTRIBUTION SYSTEM

Each of the two wells can independently supply enough water for the Town water supply demand even during peak consumption in the summer months. Chlorine is added to the well discharge to ensure adequate disinfection of any possible contamination as the water is transported through the distribution grid to consumers' homes.

Although Well #3, which is located just East of Highway 21 and Canyon Street, has the capability to supply water to the Town of Creston water distribution system, it has been isolated from the Town supply as the water quality is not as pristine as water supplied from Well #2. Well #3 remains operational and is strictly sidelined as a back-up to Well #2 in the event of any emergency, such as fire fighting, when an additional water supply might be required to maintain adequate reservoir levels.

Groundwater Well #2 is connected to the water distribution grid that supplies the Town's potable water. It is only used for a short duration each year when water demand exceeds the capacity that the Arrow Creek Water Treatment Plant is capable of supplying. This typically occurs during watering season for the numerous orchards within Town boundaries, and also during very dry summer months when rivers and streams are low. Four closed reservoirs are located at strategic geographical points within Town, ensuring that adequate supply and water pressure are maintained throughout the community.

A booster pumping station located at Schikurski Park ensures that in the event of a low water level in the Crawford Hill Reservoir located at the high point in Town, water supplied from the groundwater wells can be pumped up from the Schikurski Reservoir to Crawford Hill.

63 kilometers of water main interconnect the Town reservoirs to the community. 3056 residential connections and 239 commercial/industrial connections ensure that the Town population of 5583 (2021 Census) have unrestricted access to the Town water supply.




Schikurski Park Booster Station

4.0 SCADA SYSTEM

Critical elements of the water distribution system are monitored by in-line instrumentation that reports information back to a Supervisory Control and Data Acquisition (SCADA). A SCADA is a computer system that is used for gathering and analyzing real-time data. A SCADA system gathers information from control points, transferring the information back to a central site. It alerts the home station of any potential problems within the system, carrying out necessary analysis, and control and displays the information in a logical and organized fashion.

The Creston Water Supply SCADA monitors flow, water pressure, reservoir levels, chlorine residual, and equipment status among other critical parameters. Should any problem develop, the SCADA analyzes the situation and informs the Operations staff of the fault(s) through telephone communication, so that developing problems can be dealt with by Town staff no matter what time of day.

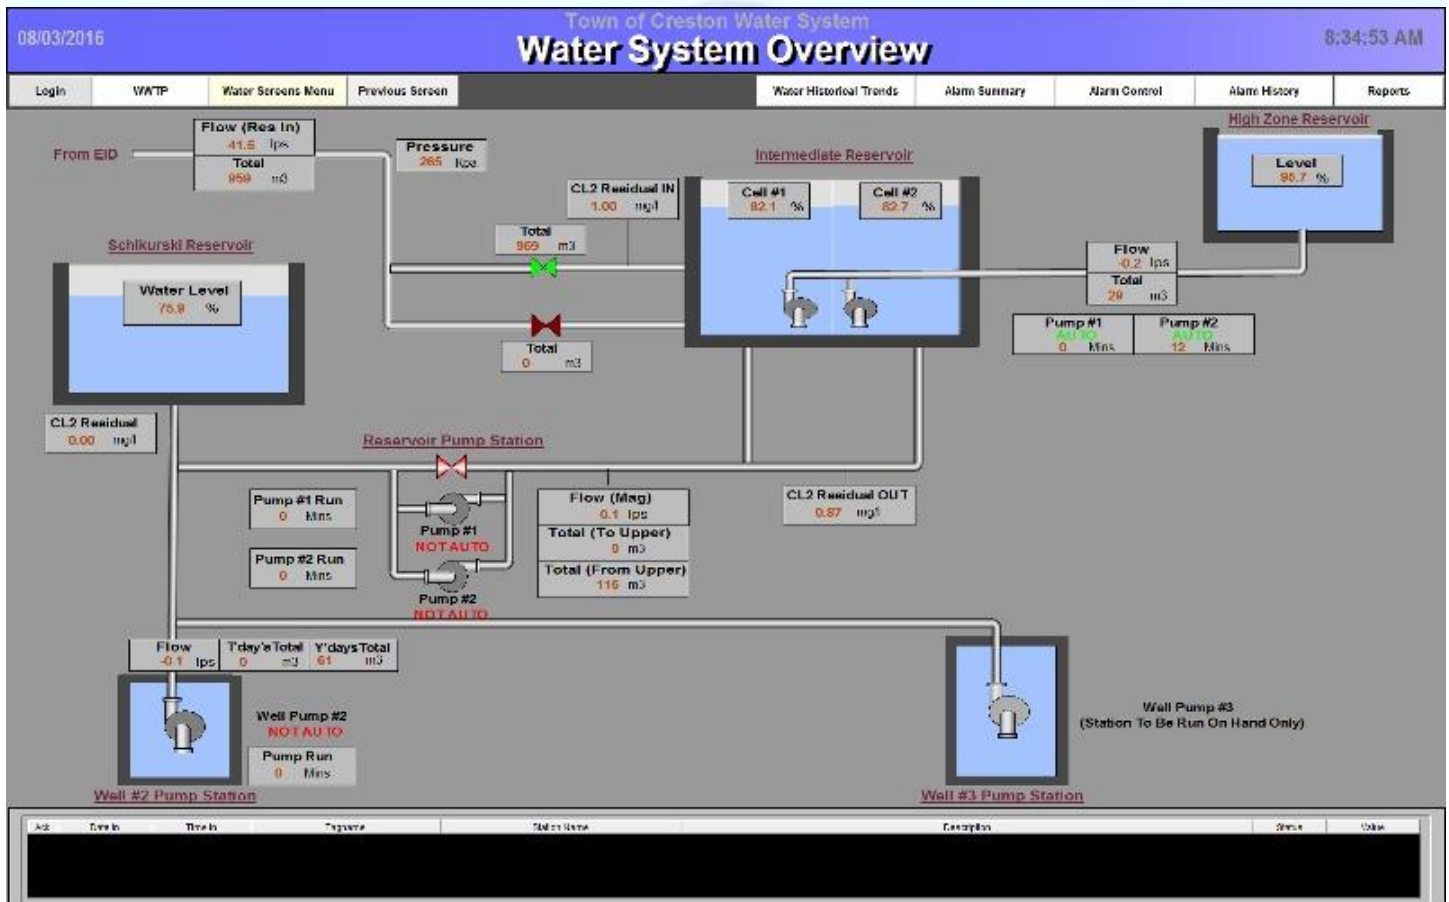

Creston Water Distribution SCADA

5.0 PROTECTING THE COMMUNITY - CRESTON'S WATER QUALITY CONTROL PROGRAM

Creston's water meets, or is better than, all federal and provincial health-related guidelines. The Town of Creston's water quality from all available potable water sources is tested bi-annually at an independent accredited Laboratory for a full spectrum of basic water chemistry parameters. As part of the water quality monitoring program, sampling for disinfection by-products (trihalomethanes and haloacetic acids) and volatile organic compounds are taken from the Crawford Hill Reservoir location, as well as representative sites at the ends of the distribution system. The full analyses of these results are posted on the Town of Creston website, www.creston.ca, and are detailed in Appendix "B" of this report.

Additionally, the Town conducts bacteriological sampling on a weekly basis for Total Coliform and Escherichia Coli (E.Coli) from various locations throughout the water distribution system. The sampling frequency and number of samples are determined by the community population. The Town of Creston conducts 6 samples on a weekly basis from locations throughout the Town water distribution system that is representative of the entire distribution grid and the individual water sources. Samples are sent to an independent accredited Laboratory for bacteriological analyses for Total and Fecal (E. Coli) Coliforms.

Should there be any indication of coliform presence in the samples, both the Town staff and Interior Health Authority are immediately notified, and procedures are put into effect to protect the community water supply as well as identify a possible source of contamination. Total Coliform testing is a bacterial indicator test for water and sanitary quality of foods. Coliforms can be found in the aquatic environment, in soil and on vegetation, and their presence is used to indicate that other pathogenic organisms of fecal origin may be present.

Of the more than 300 samples sent out for analyses in 2025, there was never a presence of E.Coli reported in the potable water supply.

Protecting our watersheds

The Town of Creston has an obligation to provide safe drinking water to the community. Even though the Town has many water quality control measures in place to ensure an innocuous water supply, the public can also contribute to protection of our water sources by:

- ◆ Proper disposal of chemicals;
- ◆ Minimizing the use of fertilizers and pesticides;
- ◆ Disposal of unused or out-of-date pharmaceuticals at your local pharmacy;
- ◆ Using recreation areas responsibly;
- ◆ Picking up after your pet; and,
- ◆ Using water wisely - conserving where you can.

6.0 WATER CONSERVATION

Since 2006, approximately when the Arrow Creek Water Treatment Facility was commissioned, detailed daily water records and measurements for the Creston community have been tabulated. Additionally, water consumption for the Columbia Brewery, Creston's single largest industrial/commercial point demand, has been kept. This data aids the Town in projecting future potable water demands in correlation with expected population growth and water usage trends.



Projected water demands for Creston through year 2030 have been modelled to allow for Capital Project water infrastructure planning, thus ensuring ample storage and delivery volumes of potable water will always be available.

Environmental considerations are undertaken when developing water distribution models for future growth. Creston developed a Water Conservation Plan in 2007. A key feature of this plan was a thorough comparison of the Town of Creston's water use patterns and efficiencies with other communities in BC and major centers around the world. The plan identified positive aspects of the Town's usage, such as finding that Creston is fairly average in per capita water use. There are some areas where water can be conserved, which ultimately would defer potential water supply increases.

In the Town of Creston, where we are surrounded by an abundance of water, it is easy to forget that water is a precious and limited resource. During the summer months, water consumption increases by as much as 50%, and during hot dry spells, water can be used up faster than the Arrow Creek Water Treatment Facility can replenish the demand.


Water conservation is the practice of permanently reducing domestic water consumption. Domestic water consumption can be divided into two major categories – inside water use and outdoor water use.

Reductions in outdoor water use have an impact all year round and help to reduce the Average Daily Demand. An additional benefit is a similar reduction in domestic wastewater flow. The Town of Creston currently implements water conservation measures such as the following:

- ◆ Stage 1 water restrictions go into effect automatically between June 1st and September 30th each year.
- ◆ Watering in the early morning and late evening to reduce evaporation losses.
- ◆ Planting native or drought resistant plant species.
- ◆ Maintaining and adjusting underground irrigation systems to eliminate overspray.

Residents can do their part by demonstrating indoor water conservation measures in their own homes by:

- ◆ Taking short showers instead of baths.
- ◆ Not running water continuously when preparing food, washing dishes by hand, shaving, or brushing teeth.
- ◆ Fixing leaky toilets and faucets.
- ◆ Using dishwashers and clothes washers only when full.
- ◆ Installation of ultra low flow toilets and showerheads. Installation of faucet aerators.

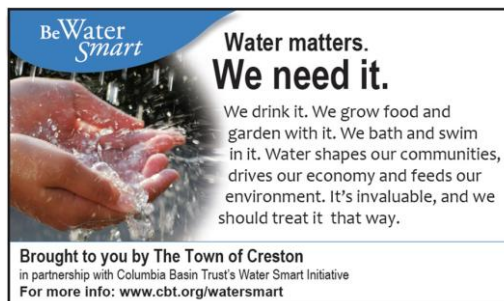

The Town of Creston offers a \$50 rebate for every CSA approved ultra low flow toilet that is installed. The Ultra Low Flow Toilet Rebate Application forms are available on the Town website (www.creston.ca) > Our Community > Environment > Water Restrictions > Water Conservation Tips and What You Can Do to Help. There have been 349 toilets replaced since 2012 with ultra low flow units.

HELP US CONSERVE WATER!
ULTRA
LOW FLOW TOILET
REBATE PROGRAM



Water conservation can benefit a variety of issues and players in the community:

- ◆ Environment and Wildlife:
 - Reduces extraction from surface and groundwater sources.
- ◆ Operations:
 - Reductions in outdoor water use, typically lawn irrigation, helping to reduce the Maximum Day and Peak Hour Demands during the summer months.
 - Reduced electrical and disinfection costs.
 - Reduced wastewater flows.
- ◆ Finances:
 - Potential for minor reduction in system size and lowered costs.
 - Reduced peak demands have the potential of deferring infrastructure costs.

7.0 WATER QUALITY COMPLAINTS - FREQUENTLY ASKED QUESTIONS

Infrequently, the Town of Creston receives water quality complaints or general questions about the water supply.

What is Fluoride?

Fluorides are chemical compounds, naturally found in air, water, soil, and almost all foods. Fluorides are commonly released into the environment by erosion resulting in natural concentrations in surface and ground waters.

Most Canadians are exposed to fluorides on a daily basis, both through trace amounts found in foods and those that are added to some drinking water supplies to prevent tooth decay.

Although fluoride is not chemically added as part of the water treatment process, fluoride naturally occurs in the Creston potable water sources in concentrations varying throughout the year, between 0.1 and 0.2 mg/L. The Town of Creston analyzes the quality of water in its watersheds and drinking water bi-annually and makes those results public on the Town of Creston website.

What is water hardness?

Water hardness is caused by calcium and magnesium in the ground and surface water. If either of these minerals are present in your drinking water in high concentrations, the water is considered hard. These minerals come from rock such as limestone that dissolves in our river system. The result of hard water is difficulty making lather or suds for washing and a build-up of minerals on taps and other fixtures.

Water containing low concentrations of calcium or magnesium is called soft water. Municipalities with soft drinking water often have higher incidences of water pipe corrosion (low pH). The degree of hardness in drinking water is commonly classified in terms of its concentration of calcium carbonate:

| Hardness Rating | Concentration of Calcium Carbonate (mg/L) | Concentration of Calcium Carbonate (grains/imperial gallon) |
|-----------------|--|---|
| Soft | 0 to <75 | 0 to <5.2 |
| Medium Hard | 75 to <150 | 5.2 to <10.5 |
| Hard | 150 to <300 | 10.5 to <21 |
| Very Hard | 300 and greater | 21 and greater |

Are there health issues with water hardness?

There are no known health effects associated with calcium and magnesium minerals in drinking water. However, conventional water softening systems (those that use salts) may not be suitable for people on sodium-reduced diets.

We recommend that consumers thoroughly research the various water softener systems available before deciding whether or not to soften their water. Also, water softeners should be connected so that the water you are drinking is not softened.

How hard is Creston's water?

The October 2025 Creston Drinking Water Analysis reporting for the Crawford Hill Reservoir recorded an average Calcium Carbonate measurement of 44.2 mg/L.

Based on that information, consultation with the chart above shows that the Town of Creston water supply has very soft water so there is no requirement for consumers to install or use water-softening equipment.

Why is Chlorine added to the Water Supply?

One of the most asked questions from consumers is about the level of chlorine in the water and why we put chlorine in the water in the first place.

We like to think our water is perfectly safe to drink. In our minds we imagine our water has been thoroughly sterilized and is 100% pure. What we do not always understand though is that our water is simply disinfected. In other words, a chemical is used to kill most germs.

Any water system that uses surface water, that is water from a lake or river, has to filter it. This filtration, along with other steps in the treatment process, will remove most everything that is harmful to humans. Yet, the water still needs to be disinfected at the very end of its treatment. Although the Arrow Creek Water Treatment Plant uses ultra-violet (UV) disinfection to destroy harmful bacteria, the problem with UV disinfection is that it is instantaneous disinfection at the UV source. Ultra-violet does not have any protracted disinfection qualities. That is where chlorine comes in.

Chlorine kills bacteria on contact but also leaves a residual in the water to keep the water disinfected until it reaches your faucet. Water leaves the Arrow Creek Water Treatment Facility sterile, but it still has to travel through many feet of pipe and reservoirs in order to make it to your home. All the time the water is traveling to you, there is a potential for contaminants to be introduced. Thus, the chlorine is still in the water to prevent any germs from making their way into the water system.

Chlorine residuals in Creston are closely monitored on a real-time basis, as well as daily chlorine residual testing taken at the Crawford Hill Reservoir, which feeds the Town's water distribution grid.

Incoming chlorine residual from the Arrow Creek water supply is monitored by an in-line analyzer, and re-chlorination is automatically administered if the incoming residual drops below a pre-set set point. As chlorine loses its disinfectant qualities through time and chemical reaction with microorganisms, the level of chlorine residual will change. Dependent on location within the water distribution grid, the chlorine residual will differ. The further from the reservoir, the lower the chlorine residual can be expected.

In order to protect consumers at the furthest distance from the reservoirs, the reservoir chlorine concentration is kept high enough to allow for a minimum free chlorine residual of 0.2 mg/L at the furthest points along the distribution grid. To achieve this, the Crawford Hill Reservoir free chlorine residual is maintained at approximately 0.85 mg/L.

Alternatives to Chlorine

Eliminating water pollution and cleaning up our watersheds are not going to happen overnight, but alternatives to chlorination for water treatment do exist. Several European and Canadian cities now disinfect their water supplies with ozone instead of chlorine. Currently, a handful of U.S. cities do the same, most notably Las Vegas, Nevada and Santa Clara, California.

There are many articles on the internet that explain the necessity for disinfection of potable water supplies and the various options that are available to consumers who prefer to remove chlorine in their water. There are many products on the market that remove chlorine residuals at the tap and are easily installed and reasonably priced.

For those of us who do not have the luxury of ozonized tap water, we do have other options. There are many websites, such as the consumer information website, WaterFilterRankings.com, that compares various water filters on the bases of price and effectiveness. The site reports that filters from Paragon, Aquasana, Kenmore, GE, and Seagul remove most, if not all, of the chlorine, THMs and other potential contaminates in tap water. Prices vary accordingly as to what particular filtration systems can strip from the water, but if all you want is to remove the incoming chlorine residual from your water supply, an activated carbon filter is recommended. Unit pricing can be under \$100 for an activated carbon filtration unit, although, when researching various filtration units, it is important to take into consideration the availability and replacement cost of filters.

Concerned consumers without the money to spend on home filtration, though, can just rely on good old-fashioned patience. Chlorine and related compounds will make their way out of tap water if the container is simply left uncovered in the refrigerator for 24 hours.

Why is my water a yellow or rusty color?

Water main repairs, construction and other maintenance work in your area can cause some rust and sediment, which normally adhere to the inside of the water main, to break away. Fire hydrant flushing can also cause this inconvenience. The discoloured water is safe to drink but may cause water to appear dirty. If this condition occurs in your system, allow a cold water tap to run for five to ten minutes to flush your pipes. If the condition persists, contact the Town of Creston at 250-428-2214.

Why does my water have a milky or cloudy appearance?

Air bubbles in the water may cause a milky or cloudy appearance. This is especially true in cold water. These bubbles pose no health risk. Cloudiness appears more often in the winter when the water is cold. If the water is allowed to sit, the air will dissipate and the water will clear.

Additionally, the use of faucet aerators create high levels of dissolved oxygen in the water, and warm or hot water will also create the effect of milky or cloudy water.

My water smells musty at one faucet?

If the musty odor occurs only at one faucet, the odor is related to something at or near the faucet. Try cleaning the drain as this often removes the odors.

Why does my water taste stale?

Drinking water may taste stale if faucets have not been used in a while. Run the water briefly to allow fresh water from the water main in the street into your plumbing. If you have any concerns about the quality of your water, please contact the Town of Creston.

8.0 ROUTINE MAINTENANCE PROGRAM

Distribution System

- ◆ Water mains are flushed using a conventional flushing program.
- ◆ Air relief valves are cleaned and serviced.
- ◆ Fire hydrants are completely disassembled and inspected on a 2-year rotation.
- ◆ Painting and brush out around hydrants is performed as needed.

Wells

- ◆ Daily security checks of wells are performed.
- ◆ Rehabilitation of wells every 5 years.
- ◆ Preventative maintenance of control valves, instrumentation and other well-related equipment is performed on a scheduled basis.
- ◆ Emergency maintenance is performed as required.
- ◆ Bi-annual full spectrum water quality testing performed.
- ◆ Weekly bacteriological analyses for Total and Fecal Coliforms conducted.

Reservoirs


- ◆ Daily security check of tanks and compounds.
- ◆ Daily checks of pump flows, chlorine and turbidity levels.

Pump Stations


- ◆ Daily inspection of all chlorination systems and all pump station equipment.
- ◆ Security checks of compounds.
- ◆ Preventative maintenance of control valves, instrumentation and other pump station related equipment is performed on a scheduled basis.

9.0 2025 CAPITAL PROJECTS

- ◆ Commissioning of Crawford Hill Reservoir backup generator.
- ◆ Replacement of water main between 21st Avenue North and 22nd Avenue North at 216 – 21st Avenue North.
- ◆ Installation of new PLC and control panel at Well #2.
- ◆ Installation of VPN server for SCADA communication with remote sites over cellular data (Schikurski Park, Well #2, Crawford Hill Reservoir).
- ◆ The Town accepted, as a developer contributed asset, 267m of water main within the McLaren Street Subdivision Phase 2 (from 1843 to 1944 McLaren Street). The work was completed under IHA Waterworks Construction Permit CP2022-140355.

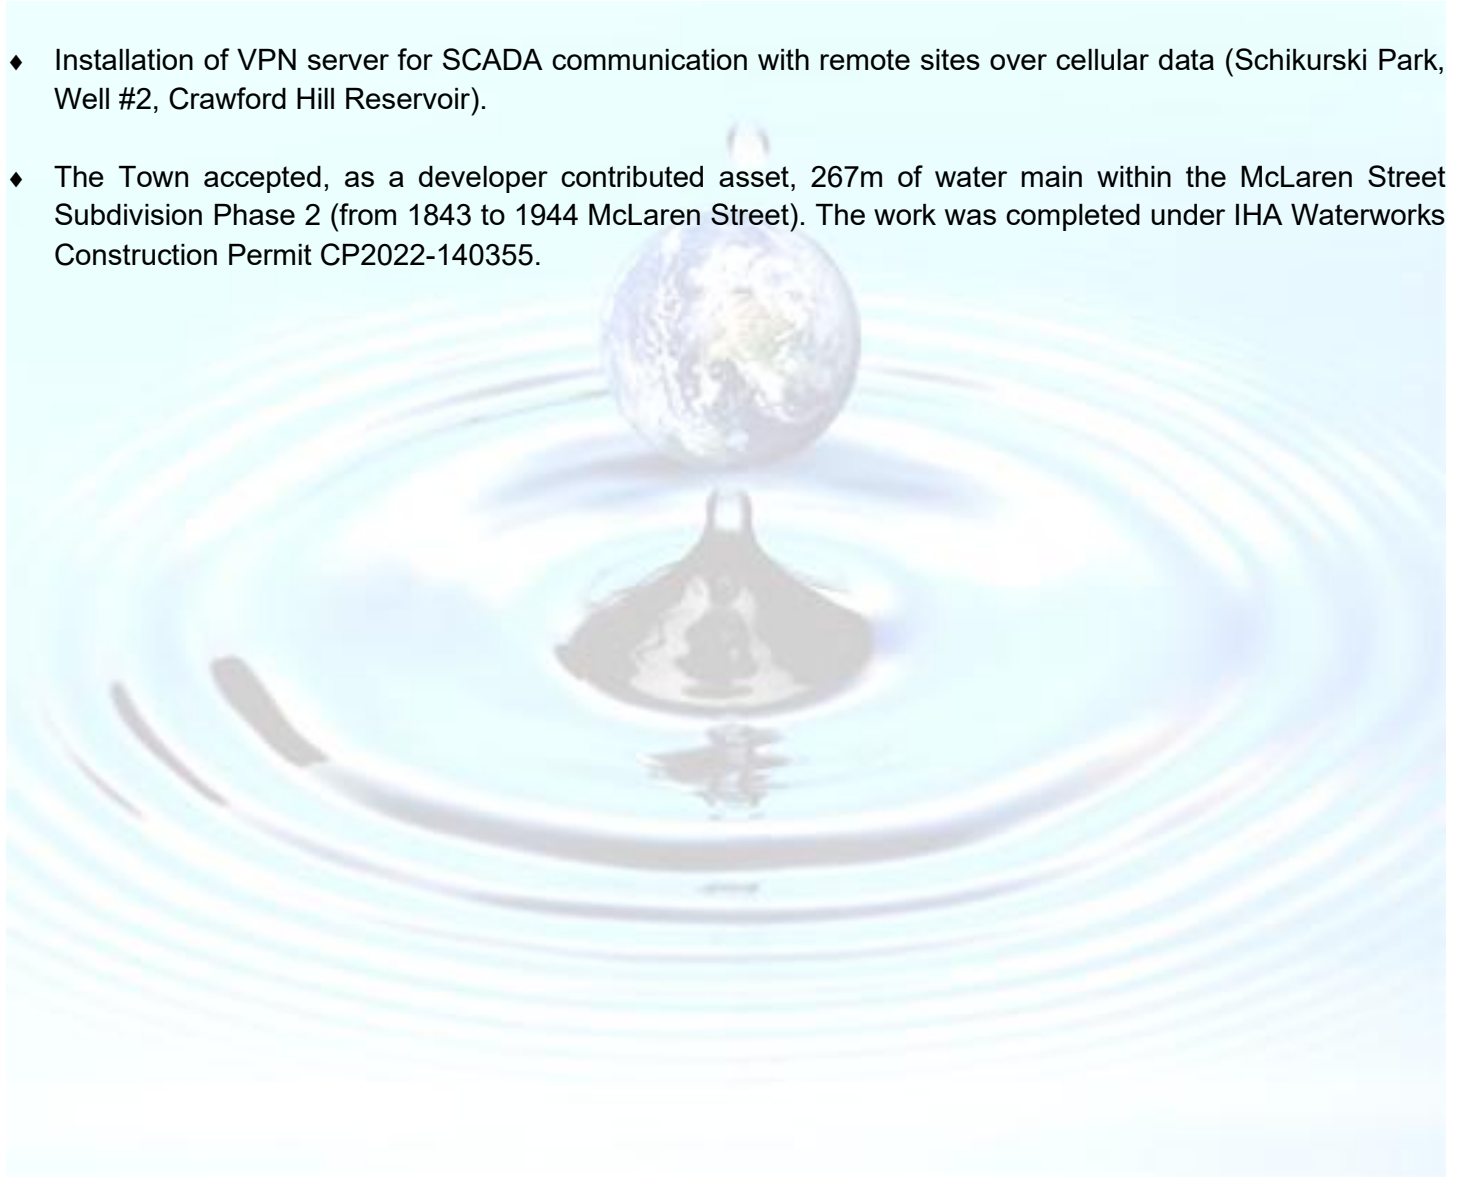

APPENDIX “A” - WELL & RESERVOIR LOCATION MAP

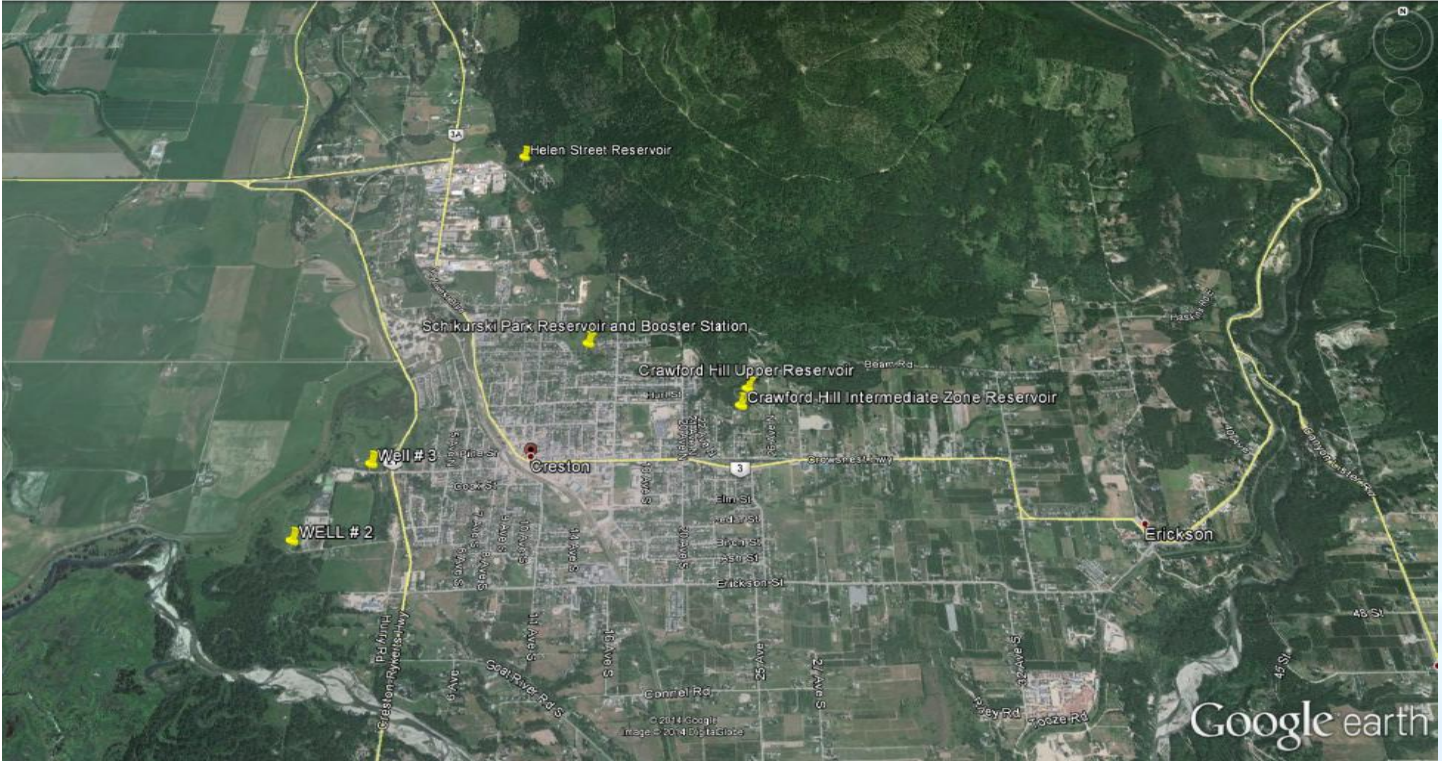

APPENDIX “B” - FULL SPECTRUM ANALYSIS

APPENDICE

mg/L = milligrams per liter (parts per million)
 NTU = Nephelometric Turbidity Units, a measure of water clarity
 AO = Aesthetic Objective
 µg = microgram (one part per billion)
 MAC = Maximum Acceptable Concentration
 MPN = Most Probable Number
 OG = Operational Guideline (treated water)
 < = “less than”
 ≤ = “less than or equal to”

Town of Creston Potable Water Analyses – April 2025

| Water Quality Parameter | Result Crawford Hill Reservoir | Result Well #2 | Result Well # 3 | Reporting Units | Canadian Drinking Water Guidelines |
|---|--------------------------------|----------------|-----------------|-----------------|------------------------------------|
| Chloride | 2.26 | 2.04 | 30.6 | mg/L | AO ≤ 250 |
| Fluoride | < 0.10 | < 0.10 | < 0.10 | mg/L | MAC = 1.5 |
| Nitrogen, Nitrate as N | 0.084 | 0.172 | 1.33 | mg/L | MAC = 10 |
| Nitrogen, Nitrite as N | < 0.010 | <0.010 | <0.010 | mg/L | MAC = 1 |
| Sulfate | 5.2 | 5.4 | 29.6 | mg/L | AO = 500 |
| Trihalomethanes - Total | 0.0407 | <0.00400 | <0.00400 | mg/L | MAC = 0.1 |
| Carbon, Total Organic | 29.0 | <0.50 | <0.50 | mg/L | N/A |
| Color, True | <5.0 | <5.0 | <5.0 | Color Unit | AO = 15 |
| pH | 7.00 | 7.14 | 7.60 | pH units | 7.0 – 10.5 |
| Turbidity | 0.15 | < 0.10 | 3.63 | NTU | OG < 1 |
| Alkalinity, Total (as CaCO ₃) | 34.5 | 57.9 | 218 | mg/L | N/A |
| Alkalinity, Phenolphthalein (as CaCO ₃) | <1.0 | <1.0 | <1.0 | mg/L | N/A |
| Alkalinity, Bicarbonate (as CaCO ₃) | 34.5 | 57.9 | 218 | mg/L | N/A |
| Alkalinity, Carbonate (as CaCO ₃) | <1.0 | <1.0 | <1.0 | mg/L | N/A |
| Alkalinity, Hydroxide (as CaCO ₃) | <1.0 | <1.0 | <1.0 | mg/L | N/A |
| Solids, Total Dissolved | 32 | 62 | 303 | mg/L | AO = 500 |
| Hardness, Total (Total as CaCO ₃) | 29.0 | 55.6 | 241 | mg/L | N/A |
| Aluminum, Total | 0.0055 | <0.0050 | 0.0165 | mg/L | OG < 0.1 |
| Antimony, Total | <0.0002 | <0.0002 | <0.0002 | mg/L | MAC = 0.006 |
| Arsenic, Total | <0.0005 | <0.0005 | <0.0005 | mg/L | MAC = 0.01 |
| Barium, Total | 0.0135 | 0.0117 | 0.0635 | mg/L | MAC = 2 |
| Beryllium, Total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Bismuth, Total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Boron, Total | <0.0500 | <0.0500 | <0.0500 | mg/L | MAC = 5 |
| Cadmium, Total | <0.00001 | <0.00001 | 0.000014 | mg/L | MAC = 0.007 |
| Calcium, Total | 8.16 | 14.3 | 54.3 | mg/L | N/A |
| Chromium, Total | <0.0005 | <0.0005 | 0.00050 | mg/L | MAC = 0.05 |
| Cobalt, Total | <0.00010 | <0.00010 | <0.00010 | mg/L | N/A |
| Copper, Total | 0.00365 | 0.00067 | 0.00288 | mg/L | MAC = 2 |
| Iron, Total | <0.01 | 0.046 | 0.776 | mg/L | AO ≤ 0.3 |
| Lead, Total | <0.0002 | <0.0002 | <0.0002 | mg/L | MAC = 0.005 |
| Lithium, Total | 0.00013 | 0.00030 | 0.00048 | mg/L | N/A |



CRESTON VALLEY

TOWN of CRESTON

| Water Quality Parameter | Result Crawford Hill Reservoir | Result Well #2 | Result Well # 3 | Reporting Units | Canadian Drinking Water Guidelines |
|----------------------------------|--------------------------------|----------------|-----------------|-----------------|------------------------------------|
| Magnesium, Total | 2.1 | 4.79 | 25.6 | mg/L | N/A |
| Manganese, Total | <0.00020 | 0.00029 | 0.00927 | mg/L | MAC =0.12 |
| Molybdenum, Total | 0.00011 | 0.00035 | 0.00051 | mg/L | N/A |
| Nickel, Total | <0.0004 | <0.0004 | 0.00073 | mg/L | N/A |
| Phosphorous, Total | <0.05 | <0.05 | <0.05 | mg/L | N/A |
| Potassium, Total | 0.37 | 0.61 | 1.66 | mg/L | N/A |
| Selenium, Total | <0.00050 | <0.0005 | <0.0005 | mg/L | MAC = 0.05 |
| Silicon, Total | 4.0 | 4.7 | 5.8 | mg/L | N/A |
| Silver, Total | <0.00005 | <0.00005 | <0.00005 | mg/L | N/A |
| Sodium, Total | 2.76 | 5.08 | 20.9 | mg/L | AO ≤ 200 |
| Strontium, Total | 0.0255 | 0.0529 | 0.258 | mg/L | MAC =7 |
| Sulfur, Total | <3.0 | <3.0 | 8.3 | mg/L | N/A |
| Tellurium, Total | <0.0005 | <0.0005 | <0.0005 | mg/L | N/A |
| Thallium, Total | <0.00002 | <0.00002 | <0.00002 | mg/L | N/A |
| Thorium, Total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Tin, Total | <0.0002 | <0.0002 | <0.0002 | mg/L | N/A |
| Titanium, Total | <0.005 | <0.005 | <0.005 | mg/L | N/A |
| Tungsten, Total | <0.0010 | <0.0010 | <0.0010 | mg/L | N/A |
| Uranium, Total | 0.000064 | 0.000165 | 0.0197 | mg/L | MAC = 0.02 |
| Vanadium, Total | <0.005 | <0.005 | <0.005 | mg/L | N/A |
| Zinc, Total | <0.004 | <0.004 | 0.0171 | mg/L | AO ≤ 5 |
| Zirconium, Total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Bromodichloromethane | <0.001 | <0.001 | <0.001 | mg/L | N/A |
| Bromoform | <0.001 | <0.001 | <0.001 | mg/L | N/A |
| Chloroform | 0.0407 | <0.001 | <0.001 | mg/L | N/A |
| Dibromochloromethane | <0.001 | <0.001 | <0.001 | mg/L | N/A |
| Surrogate: Toulene-d8 | 75 | | | 70 – 130% | N/A |
| Surrogate: 4-Bromofluorobenzene | 67 | | | 70 – 130% | N/A |
| Monochloroacetic Acid | <0.0020 | | | mg/L | N/A |
| Monobromoacetic Acid | <0.0020 | | | mg/L | N/A |
| Dichloroacetic Acid | 0.0191 | | | mg/L | N/A |
| Trichloroacetic Acid | 0.0268 | | | mg/L | N/A |
| Dibromoacetic Acid | <0.0020 | | | mg/L | N/A |
| Total Haloacetic Acids (HAA5) | 0.0459 | | | mg/L | MAC = 0.08 |
| Surrogate: 2-Bromopropionic Acid | 108 | | | 70 – 130% | |

Town of Creston Potable Water Analyses – April 2025

| Water Quality Parameter | Result Centennial Park | Result Public Works Town Shop | Reporting Units | Canadian Drinking Water Guidelines |
|---|------------------------|-------------------------------|-----------------|------------------------------------|
| Total Trihalomethanes | 0.0609 | 0.0479 | mg/L | MAC = 0.1 |
| Carbon, Total Organic | 2.07 | 1.32 | mg/L | N/A |
| Bromodichloromethane | 0.0012 | <0.001 | mg/L | N/A |
| Bromoform | <0.001 | <0.001 | mg/L | N/A |
| Chloroform | 0.0597 | <0.001 | mg/L | N/A |
| Dibromochloromethane | <0.001 | <0.001 | mg/L | N/A |
| <i>Surrogate: Toulene-d8</i> | 75 | 81 | 70-130% | N/A |
| <i>Surrogate: 4-Bromofluorobenzene</i> | 64 | 68 | 70-130% | N/A |
| Monochloroacetic Acid | 0.0028 | 0.0020 | mg/L | N/A |
| Monobromoacetic Acid | <0.0020 | <0.0020 | mg/L | N/A |
| Dichloroacetic Acid | 0.0321 | 0.0238 | mg/L | N/A |
| Trichloroacetic Acid | 0.0388 | 0.0361 | mg/L | N/A |
| Dibromoacetic Acid | <0.0020 | <0.0020 | mg/L | N/A |
| Total Haloacetic Acids (HAA5) | 0.0737 | 0.0619 | mg/L | MAC = 0.08 |
| <i>Surrogate: 2-Bromopropionic Acid</i> | 125 | 129 | 70 – 130% | |

Town of Creston Potable Water Analyses – October 2025

| Water Quality Parameter | Result Crawford Hill Reservoir | Result Well #2 | Result Well #3 | Reporting Units | Canadian Drinking Water Guidelines |
|---|--------------------------------|----------------|----------------|-----------------|------------------------------------|
| Chloride | 154 | 3.05 | 29.6 | mg/L | AO ≤ 250 |
| Fluoride | < 0.10 | <0.10 | <0.10 | mg/L | MAC = 1.5 |
| Nitrogen, Nitrate as N | <0.010 | 0.220 | 0.079 | mg/L | MAC = 10 |
| Nitrogen, Nitrite as N | <0.010 | < 0.010 | <0.010 | mg/L | MAC = 1 |
| Sulfate | 5.9 | 5.6 | 27.8 | mg/L | AO = 500 |
| Trihalomethanes - Total | 0.0145 | | | mg/L | MAC = 0.1 |
| Carbon, Total Organic | 0.61 | 0.68 | 0.60 | Mg/L | N/A |
| Color, True | <5.0 | <5.0 | <5.0 | Color Unit | AO = 15 |
| pH | 6.65 | 6.75 | 7.40 | pH units | AO = 7.0 – 10.5 |
| Turbidity | < 0.10 | 0.12 | 1.08 | NTU | OG < 1 |
| Alkalinity, Total (as CaCO ₃) | 54.3 | 69.6 | 240 | mg/L | N/A |
| Alkalinity, Phenolphthalein (as CaCO ₃) | <1.0 | <1.0 | <1.0 | mg/L | N/A |
| Alkalinity, Bicarbonate (as CaCO ₃) | 54.3 | 69.6 | 240 | mg/L | N/A |
| Alkalinity, Carbonate (as CaCO ₃) | <1 | <1 | <1 | mg/L | N/A |
| Alkalinity, Hydroxide (as CaCO ₃) | <1 | <1 | <1 | mg/L | N/A |
| Solids, Total Dissolved | 59 | 69 | 340 | mg/L | AO = 500 |
| Hardness, Total (Total as CaCO ₃) | 44.2 | 59 | 264 | mg/L | N/A |
| Aluminum, total | <0.0050 | <0.0050 | <0.0050 | mg/L | OG < 0.1 |
| Antimony, total | <0.00020 | <0.00020 | <0.00020 | mg/L | MAC = 0.006 |
| Arsenic, total | <0.0005 | <0.0005 | 0.00050 | mg/L | MAC = 0.01 |
| Barium, total | 0.0218 | 0.0132 | 0.0661 | mg/L | MAC = 2 |
| Beryllium, total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Bismuth, total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Boron, total | <0.0500 | <0.0500 | <0.0500 | mg/L | MAC = 5 |
| Cadmium, total | <0.00001 | <0.00001 | <0.00001 | mg/L | MAC = 0.005 |
| Calcium, total | 12.5 | 14.9 | 58.2 | mg/L | N/A |
| Chromium, total | <0.00050 | <0.00050 | <0.0005 | mg/L | MAC = 0.05 |
| Cobalt, total | <0.00010 | <0.00010 | <0.00010 | mg/L | N/A |
| Copper, total | <0.00040 | 0.00161 | 0.00101 | mg/L | MAC = 2 |
| Iron, total | <0.01 | <0.01 | 0.320 | mg/L | AO ≤ 0.3 |
| Lead, total | <0.0002 | <0.0002 | <0.0002 | mg/L | MAC = 0.005 |
| Lithium, total | 0.00016 | 0.00029 | 0.00046 | mg/L | N/A |
| Magnesium, total | 3.16 | 5.29 | 28.8 | mg/L | N/A |
| Manganese, total | <0.00020 | <0.00020 | 0.00530 | mg/L | MAC = 0.12 |
| Molybdenum, total | 0.00016 | 0.00035 | 0.00057 | mg/L | N/A |
| Nickel, total | <0.00040 | <0.00040 | 0.00040 | mg/L | N/A |
| Phosphorous, total | <0.05 | <0.05 | <0.05 | mg/L | N/A |
| Potassium, total | 0.47 | 0.65 | 1.76 | mg/L | N/A |

| Water Quality Parameter | Result Crawford Hill Reservoir | Result Well #2 | Result Well #3 | Reporting Units | Canadian Drinking Water Guidelines |
|--|--------------------------------|-----------------|----------------|-----------------|------------------------------------|
| Selenium, total | <0.00050 | <0.00050 | <0.00050 | mg/L | MAC = 0.05 |
| Silicon, total | 4.2 | 4.7 | 5.9 | mg/L | N/A |
| Silver, total | <0.00005 | <0.00005 | <0.00005 | mg/L | N/A |
| Sodium, total | 2.48 | 5.08 | 22.1 | mg/L | AO ≤ 200 |
| Strontium, total | 0.0358 | 0.0552 | 0.268 | mg/L | MAC = 7 |
| Sulfur, total | <3.0 | <3.0 | 9.4 | mg/L | N/A |
| Tellurium, total | <0.0005 | <0.0005 | <0.0005 | mg/L | N/A |
| Thallium, total | <0.00002 | <0.00002 | <0.00002 | mg/L | N/A |
| Thorium, total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Tin, total | <0.0002 | <0.0002 | <0.0002 | mg/L | N/A |
| Titanium, total | <0.005 | <0.005 | <0.005 | mg/L | N/A |
| Tungsten, Total | <0.0010 | <0.0010 | <0.0010 | mg/L | N/A |
| Uranium, total | 0.000112 | 0.000165 | 0.0206 | mg/L | MAC = 0.02 |
| Vanadium, total | <0.005 | <0.005 | <0.005 | mg/L | N/A |
| Zinc, total | <0.004 | <0.004 | 0.0056 | mg/L | AO ≤ 5 |
| Zirconium, total | <0.0001 | <0.0001 | <0.0001 | mg/L | N/A |
| Bromodichloromethane | <0.001 | | | mg/L | N/A |
| Bromoform | <0.001 | | | mg/L | N/A |
| Chloroform | 0.0145 | | | mg/L | N/A |
| Dibromochloromethane | <0.001 | | | mg/L | N/A |
| <i>Surrogate: Toulene-d8</i> | 96 | | | 70-130% | N/A |
| <i>Surrogate: 4-Bromofluorobenzene</i> | 79 | | | 70-130% | N/A |

Town of Creston Potable Water Analyses – October 2025

| Water Quality Parameter | Result Creston Public Library | Result Public Works Town Shop | Reporting Units | Canadian Drinking Water Guidelines |
|---|-------------------------------|-------------------------------|-----------------|------------------------------------|
| Total Trihalomethanes | 0.0204 | 0.0185 | mg/L | MAC = 0.1 |
| Bromodichloromethane | <0.0010 | <0.001 | mg/L | N/A |
| Bromoform | <0.001 | <0.001 | mg/L | N/A |
| Chloroform | 0.0204 | 0.0185 | mg/L | N/A |
| Dibromochloromethane | < 0.001 | < 0.001 | mg/L | N/A |
| <i>Surrogate: Toulene-d8</i> | 96 | 91 | 70 – 130% | N/A |
| <i>Surrogate: 4-Bromofluorobenzene</i> | 80 | 80 | 70 – 130% | N/A |
| Monochloroacetic Acid | <0.0040 | <0.0040 | mg/L | N/A |
| Monobromoacetic Acid | <0.0020 | <0.0020 | mg/L | N/A |
| Dichloroacetic Acid | 0.0143 | 0.0118 | mg/L | N/A |
| Trichloroacetic Acid | 0.0109 | 0.0128 | mg/L | N/A |
| Dibromoacetic Acid | <0.0020 | <0.0020 | mg/L | N/A |
| Total Haloacetic Acids (HAA5) | 0.0251 | 0.0246 | mg/L | MAC = 0.08 |
| <i>Surrogate: 2-Bromopropionic Acid</i> | 108 | 106 | 70 – 130% | |

Microbiological Organisms (<1 means not detected)

| Water Quality Parameter | Units | Canadian Drinking Water Guidelines | | | Major Source |
|-------------------------|------------|------------------------------------|---------|---------|--|
| | | Crawford Hill Reservoir | Well #2 | Well #3 | |
| E.Coli | MPN/100 mL | <1 | <1 | <1 | Domestic animals, wildlife and human waste |
| Total Coliform | /100 mL | <1 | <1 | *** | Soil, domestic animals and wildlife |

Bacteriological testing for E.Coli and Total Coliforms are conducted weekly from various locations throughout the water distribution system, including the Crawford Hill Reservoir and Wells #2 and #3. All bacteriological samples taken during 2025 were analyzed as negative for both E.Coli and Total Coliform counts.